


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

**SLOPE** - RAMP WIDTH SHALL NOT EXCEED 1" RISE IN 12" OF RUN, OR 8.33% MAX. SLOPE.


**FINISH** - CENTER RAMP SHALL HAVE HERRINGBONE GROOVES 1/4" DEEP BY 1/4" WIDE, 1-1/2" APART AS SHOWN. REMAINING RAMP SHALL BE NON-SLIP HEAVY BROOM FINISH OR EQUAL TO PROVIDE CONTRASTING FINISH WITH ADJACENT SIDEWALK.

**CONCRETE** - THE RAMP SLAB SHALL BE 4" THICK WITH 4" OF COMPACTED CLASS II AGG. BASE OR SAND, 5 SACK CRUSHED AGGREGATE AT 2500 PSI


**SCORING** - RAMP SHALL HAVE 12 PARALLEL GROOVES, 1/4" WIDE BY 1/4" DEEP, 3/4" APART. FOR ADDITIONAL REQUIREMENTS SEE CALTRANS STD. DETAILS.

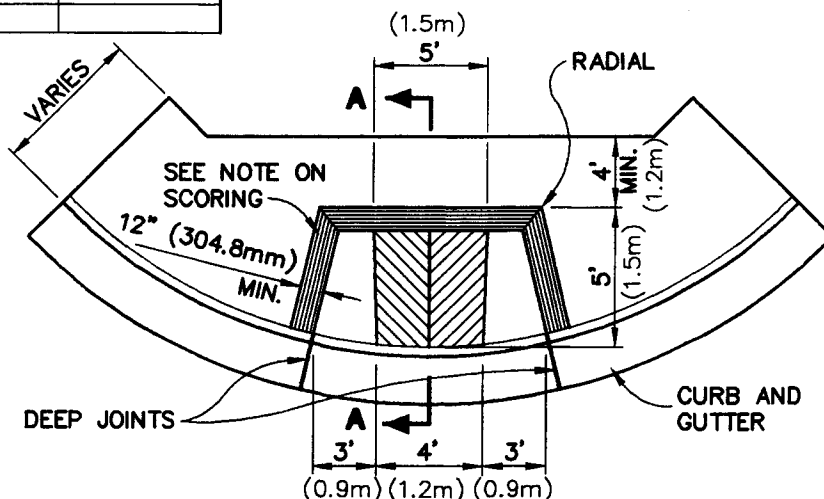


### CURB RETURN RAMP

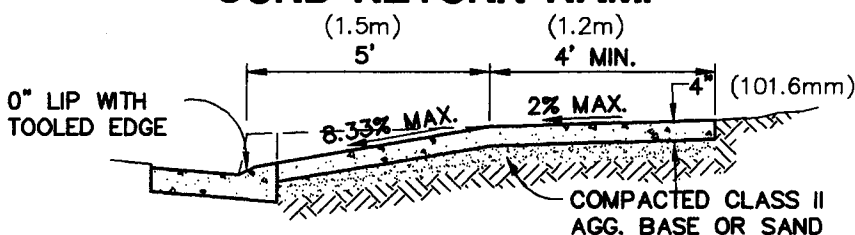

### SECTION A-A

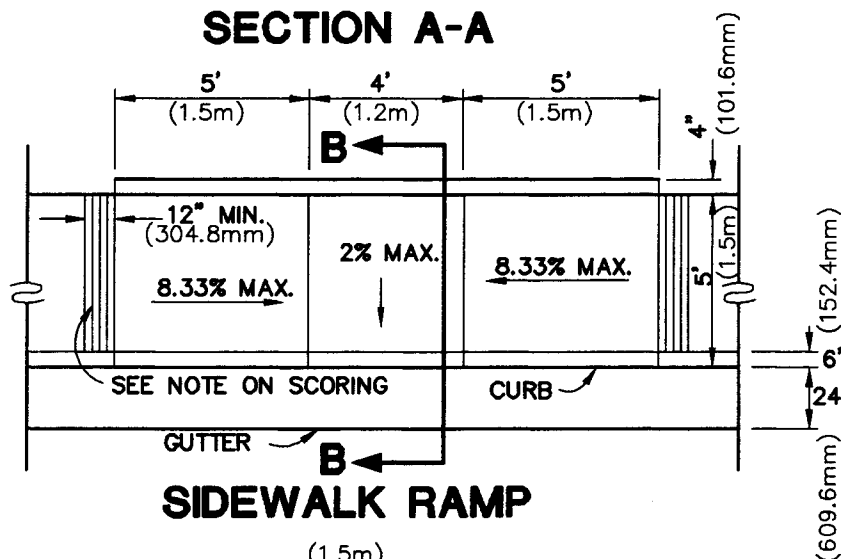

### SIDEWALK RAMP

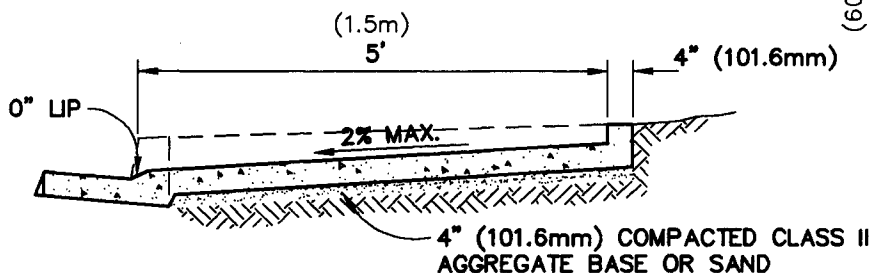

### SECTION B-B

DRAWN BY:  
C.A.C.  
DESIGNED BY:

DATE:  
4/18/94  
FILE NAME:  
PR-B-9.DWG

CITY OF PASO ROBLES  
ENGINEERING DIVISION

HANDICAP RAMP

DRAWING NO.

B-9